

**TEMPERATURE CONTROLLER QUOTATION WORKSHEET**

AGENT ..... Date ..... Customer .....  
 Contacted person ..... Adress .....  
 Phone ..... Fax ..... E-mail .....

Total number of zones: .....

Number of hot runner zones: .....

Number of heating band zones:.....

Number of nozzles zones: .....

Length of feeding cable: .....

Length of mould connecting cables:.....

MAX 3500W for zone

W:.....

MAX 1200W for zone

W:.....

MAX 1200W for zone

W:.....

Standard

meters:.....

Standard

meters:.....

Feeding power:.....

400V 3 F + N +

240V 3 F + N +


240V F + N + (max 2 zones)

Other: .....

Attached schemes for connection to mould: .....

Connection schemes according to Thermoplay standard: .....

**SCHEMES FOR CONNECTION TO MOULD ACCORDING TO COSTUMER NEEDS.**

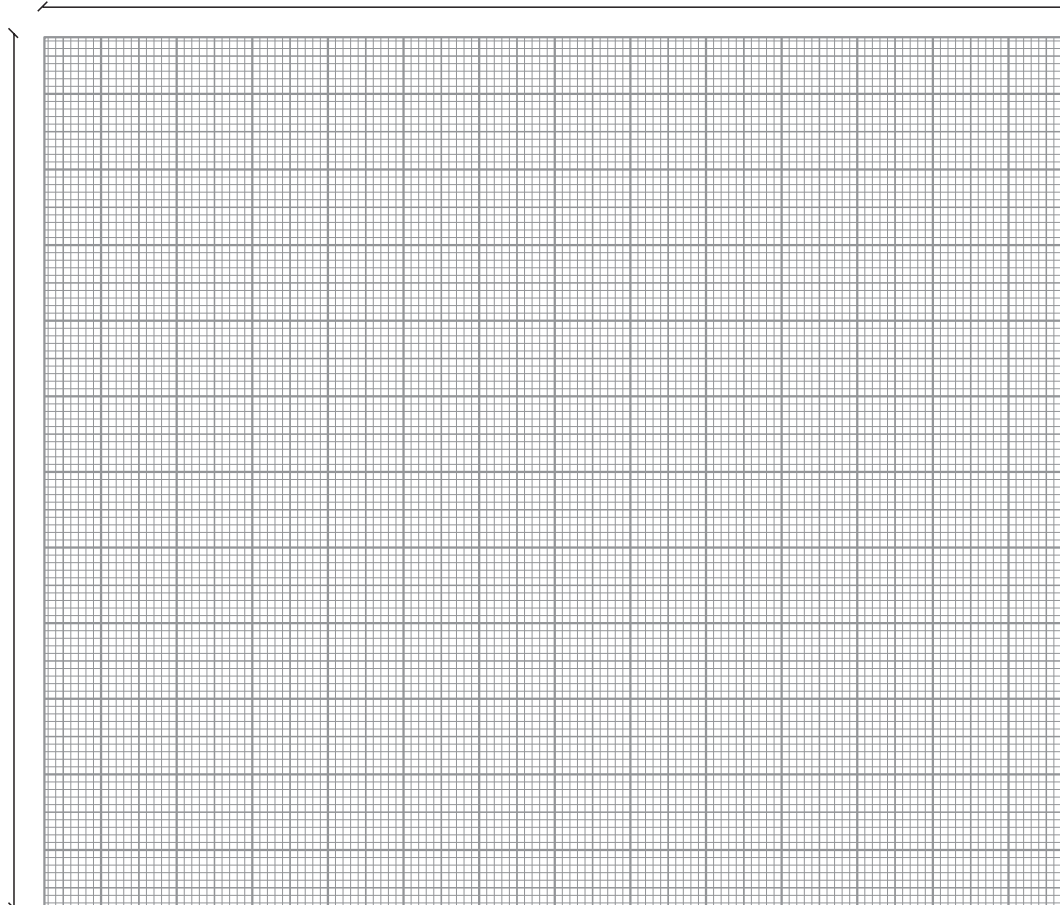

NOTES: